


# HEW-THERM CS-150-UNI-PI

## COLD APPLIED LOW PROFILE POWER CONNECTION

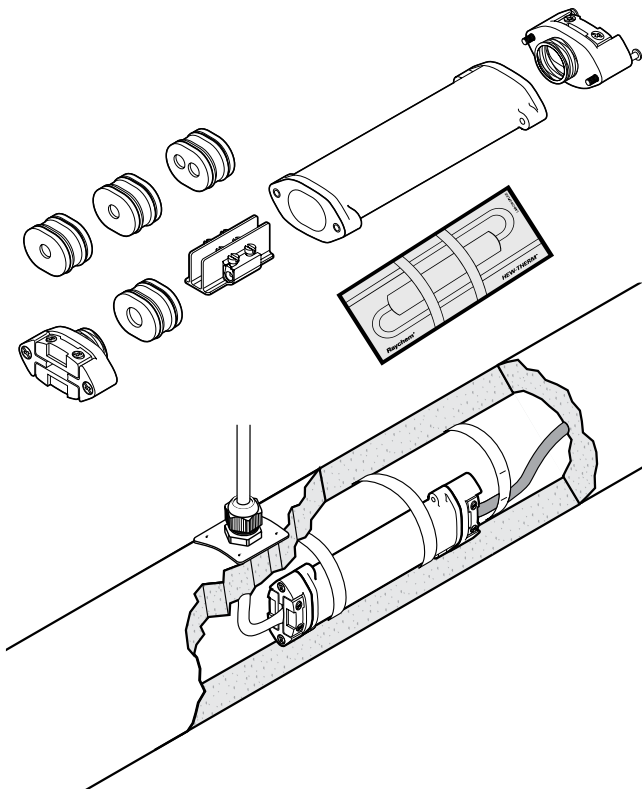

The CS-150-UNI-PI is a universal low profile heating cable connector for the direct connection of single conductor Polymer Insulated (PI) series heating cables. It can be used in different configurations: for the connection of a cold lead to a heating cable (Variant C), as an under insulation connecting system for the connection of a three core power cable to a heating cable loop (Variant L), as well as for splicing two heating cables (Variant S).

The connector is certified for use in hazardous areas and doesn't require a hot work permit. The electrical connection is realized by means of screw terminals, so no special crimp tools are required. If used as a connection kit, an additional gland needs to be ordered separately.

### APPLICATION

"Cold" applied connection/splice for a single conductor polymer insulated (PI) series heating cables with an external diameter between 3.2 and 6.4 mm.

In hazardous area use only with ATEX approved heating cable.

The CS-150-UNI-PI can be used in different configurations:

- connection of a heating cable to a cold lead cable 1 x 2.5 mm<sup>2</sup> or 1 x 4 mm<sup>2</sup> (Variant C)
- connection of a heating cable to a power cable 3 x 2.5 mm<sup>2</sup> (Variant L)
- splice of two heating cables (Variant S)

### KIT CONTENTS


- 1 x temperature resistant and impact proof body.
- 1 x screw terminal block
- 4 x rubber seals (to be used according to application)
- 2 x strain relieve clamps with screws
- 1 x identification label
- 1 x tube of lubricant
- 1 x installation instruction

**APPROVALS**

PTB 09 ATEX 1067U  
 Ⓢ II 2G Ex e II  
 Ⓢ II 2D Ex tD A21 IP66  
 IECEX PTB 09.0042U  
 Ex e II  
 Ex tD A21 IP 66  
 Ex e II / Ex tD A21 IP66

This product also has all required approvals for use in Kazakhstan, Russia and other countries. Contact your local Pentair Thermal Management representative for more details. Particular measures to maintain the T-classification of polymer insulated heating cables are to be taken in accordance with the appropriate EC - Type examination certificate (also refer to installation instructions). Type examination certification applies for the use of ATEX certified polymer insulated (PI) series heating cables.

**DIMENSIONS (IN MM)**

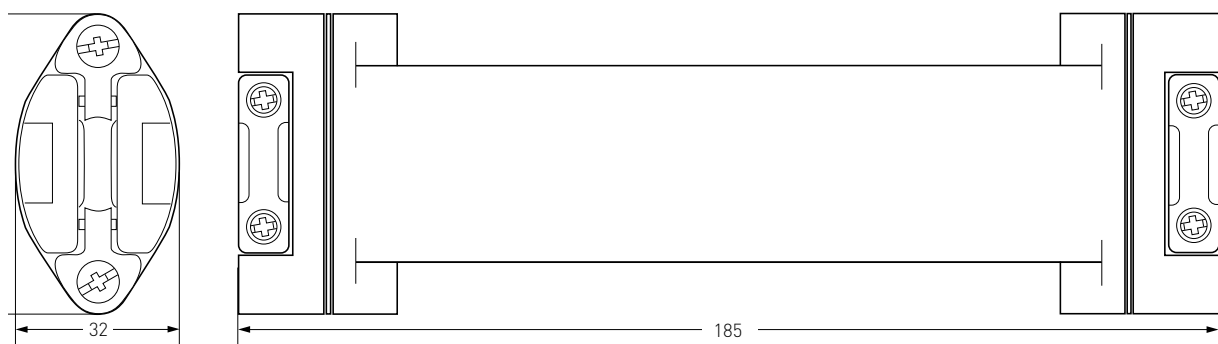

**HEATING CABLE TYPES**

Heating cable capability XPI-NH, XPI and XPI-S polymer insulated (PI) series resistance cable, for other types contact Pentair Thermal Management

**MATERIALS OF CONSTRUCTION**

Housing, connection Glass fibre reinforced temperature resistant engineering plastic  
 Support ring, spacer, screws and spring Stainless steel  
 Cable seals Silicon rubber

**MAXIMUM OPERATING TEMPERATURE (\*)**

Power on: 180°C (may be limited by the temperature resistance of the supply cable)  
 Power off: 210°C (using variant L, dependent on the type of supply cable e.g. 200°C for silicon cables, unless the power cable connection is bent sufficiently far away from the heated surface).

**MINIMUM INSTALLATION TEMPERATURE**

-50°C

**MAX. OPERATING VOLTAGE**

Variant C and S = 750 Vac  
 Variant L = 420 Vac

**MAX. ALLOWED WATTAGE**

The max. allowed cable output is limited depending on the application. Refer to the installation instruction for details.

**MAX. ALLOWED WATTAGE**

The max. allowed cable output is limited depending on the application. Refer to the installation instruction for details.

**MAX. PERMITTED NOMINAL CURRENT (\*)**

Variant S: 32 A  
 Variant C with 1 x 2.5 mm<sup>2</sup> supply cable: 25 A  
 Variant C with 1 x 4 mm<sup>2</sup> supply cable: 32 A  
 Variant L with 3 x 2.5 mm<sup>2</sup> supply cable up to 150°C: 25 A  
 Variant L with 3 x 2.5 mm<sup>2</sup> supply cable 151°C to 180°C: 20 A

**SUPPLY CABLE DIMENSIONS**

-> Multi-stranded copper conductors 3 x 2.5 mm<sup>2</sup>, Ø 7.8 - 12.5 mm<sup>2</sup>  
 -> Single conductor cold lead, max. 1 x 4 mm<sup>2</sup>, Ø 3.2 - 6.4 mm

**SUPPLY CABLE REQUIREMENTS**

The maximum permissible voltage drop is to be taken into consideration when selecting the cross-section of the power cable.

The maximum working temperature of the CS-150-UNI-PI can be reduced through the maximum permitted continuous use temperature of the supply cable, unless the supply cable is laid (at a sufficient distance from the heated surface) so that the maximum permitted continuous use temperature will not be exceeded. A suitable power cable is the silicon insulated cable type C-150-PC.

**ACCESSORIES**

Cable gland GL-36-M25 hazardous area approved gland for 8-17 mm power cables diameter  
 GL-44-M20-KIT hazardous area approved gland for PI cables.

**ORDERING DETAILS**

Order reference CS-150-UNI-PI  
 Part number (Weight) A45371-000 (0.4 kg)

(\*) For the full range of technical design details of the CS-150-UNI-PI refer to the installation instructions (INSTALL-064)



[WWW.PENTAIRTHERMAL.COM](http://WWW.PENTAIRTHERMAL.COM)

**EUROPE, MIDDLE EAST, AFRICA**

Tel: +32.16.213.511  
Fax: +32.16.213.603  
[thermal.info@pentair.com](mailto:thermal.info@pentair.com)

**UNITED KINGDOM**

Tel: 0800 969 013  
Fax: 0800 968 6241  
[salesthermaluk@pentair.com](mailto:salesthermaluk@pentair.com)

**IRELAND**

Tel: 1800 654 241  
Fax: 1800 654 240  
[salesie@pentair.com](mailto:salesie@pentair.com)

All Pentair trademarks and logos are owned by Pentair. All other brand or product names are trademarks or registered marks of their respective owners. Because we are continuously improving our products and services, Pentair reserves the right to change specifications without prior notice. Pentair is an equal opportunity employer.

© 2013 Pentair. All Rights Reserved.